

Indicated parking lots will have 10 EV charging units. Each location will have one that is accessible. New distribution panels, transformers, conduits and wiring will be provided as required.

Lot A: Convert 2 existing outlets to 2 EV charging units. Existing conduit may be reused to avoid trenching to power source.


2. 23A: Convert 2 existing outlets to 2 EV charging units. Existing conduit may be reused to avoid trenching to power source.

3. Lot B: Power to come from existing xformer across Building 3 (Lot B4). New conduits and wiring will cross B4 driveway.

4. Lot H: Power to come from existing transformer, adjacent to Lot H.

5. Lot G: Power to come from existing transformer across 29th. Dependent on Central Plant Upgrade project to run conduit across Bonita Dr.

6. Lot F: Power to come from existing transformer across 29th. Dependent on Central Plant Upgrade project to run conduit across Bonita Dr.

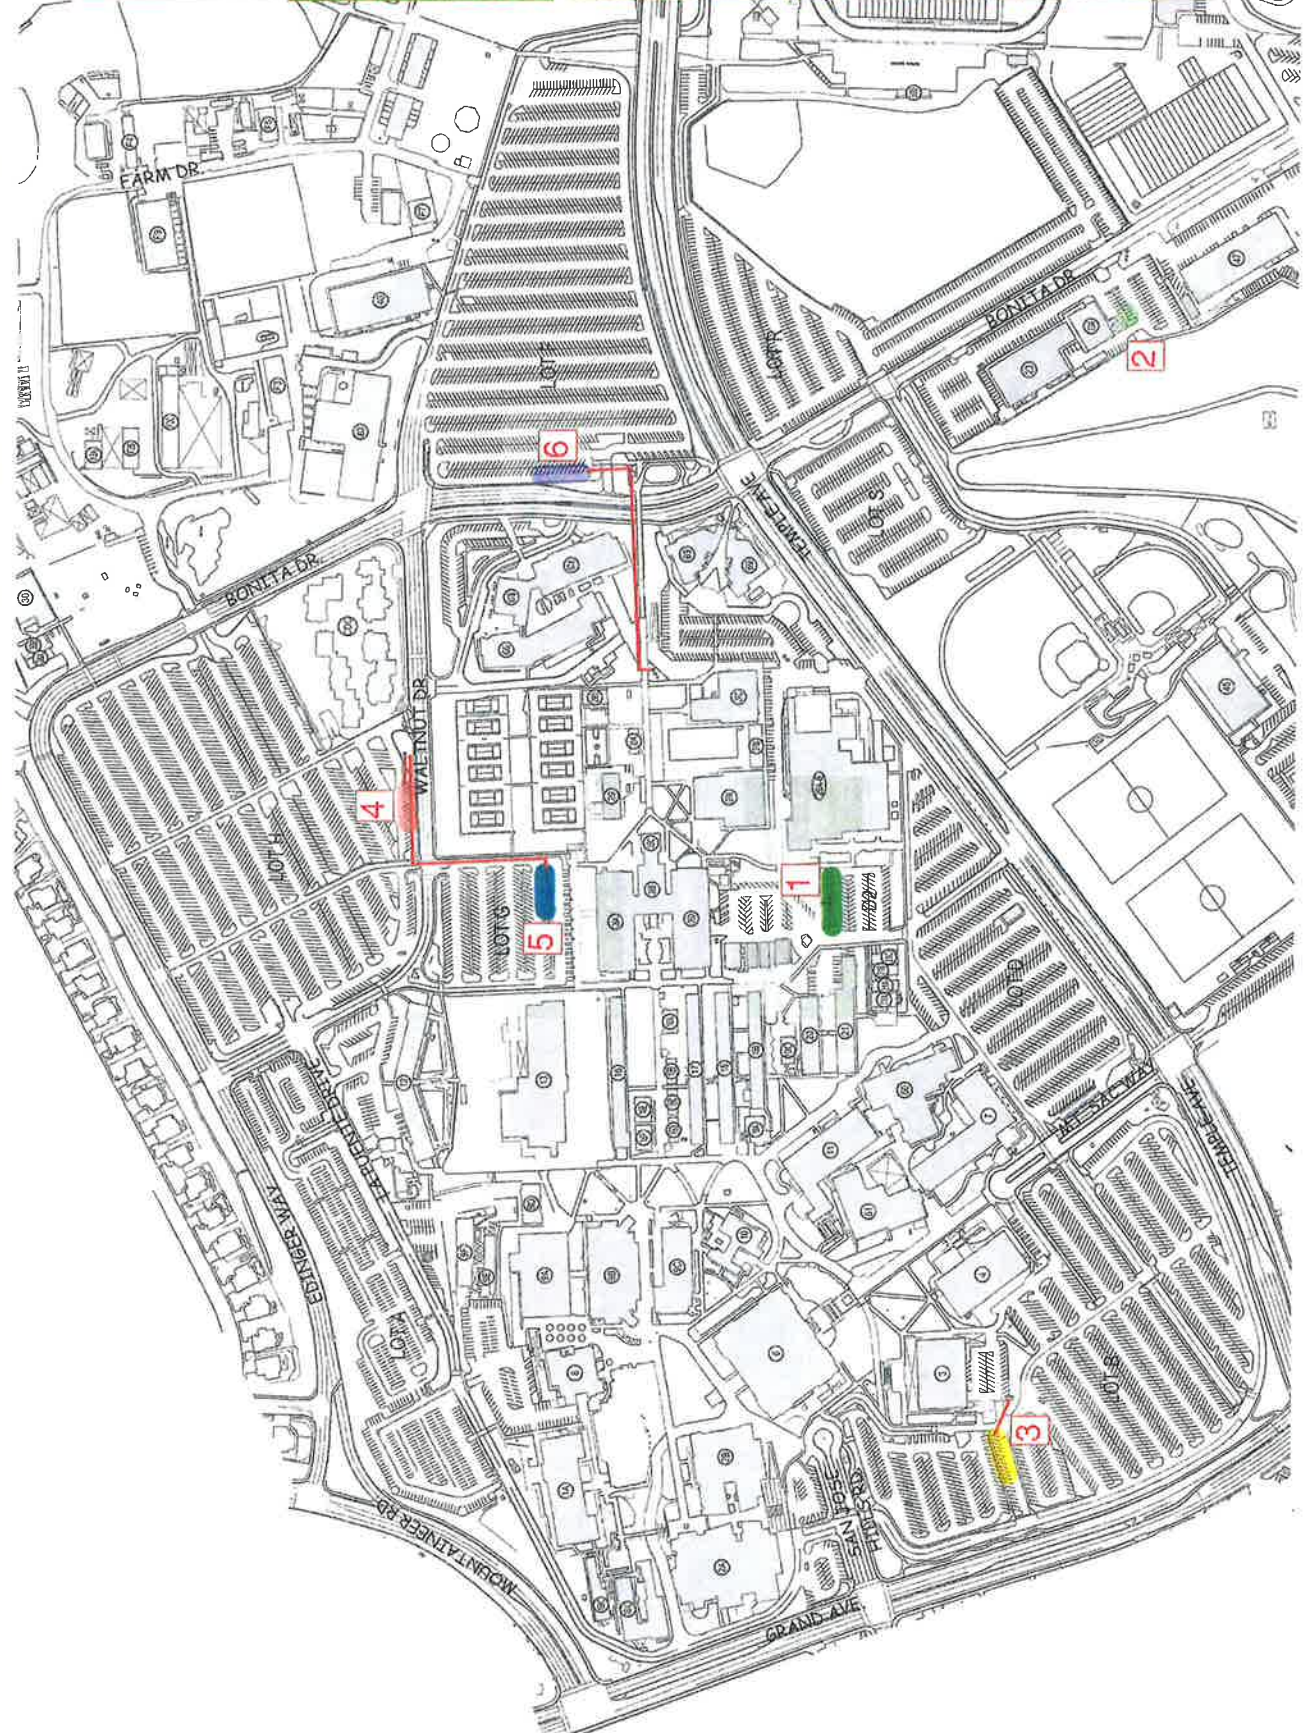




CENTRAL PRECINCT PLANNING Mt. San Antonio College

OPTION 7



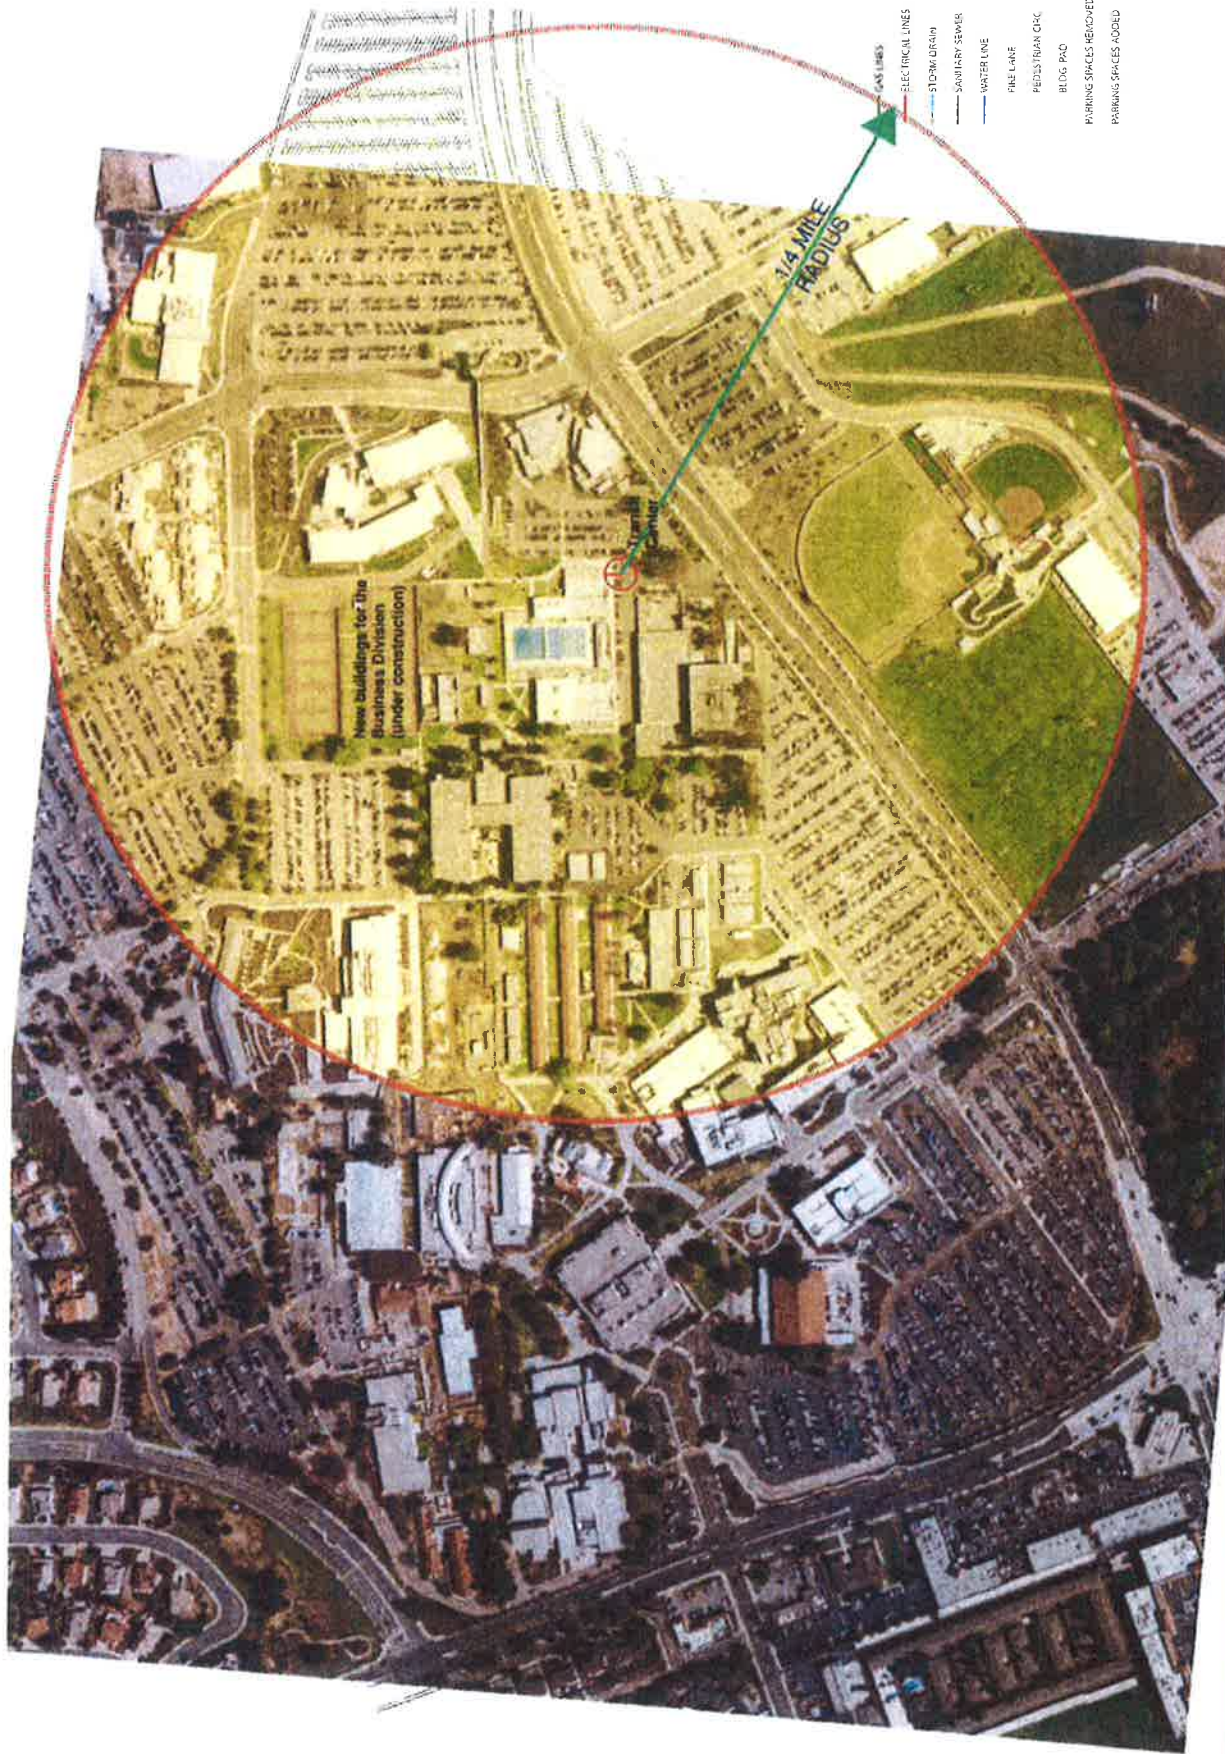

CENTRAL PRECINCT PLANNING Mt. San Antonio College

OPTION 7

